


J-BOX INSTALLATION BOM	
COMET P/N	DESCRIPTION
400597	ENCLOSURE, J-BOX, NEMA 3
400386	CONDUIT, M ADAPTOR, 3IN, PVC, SCH40
400390	LOCKNUT, 3IN, STEEL, FOR PVC M ADAPTOR
402290	UNISTRUT, PREGALV, SLOTTED, 1-5/8IN, 10IN
400549	NUT, SPRING, 1/4-20, Z/P
400550	BOLT, HEX, 1/4-20, 1 1/4IN, Z/P
402291	DIN RAIL, SLOTTED, 6IN

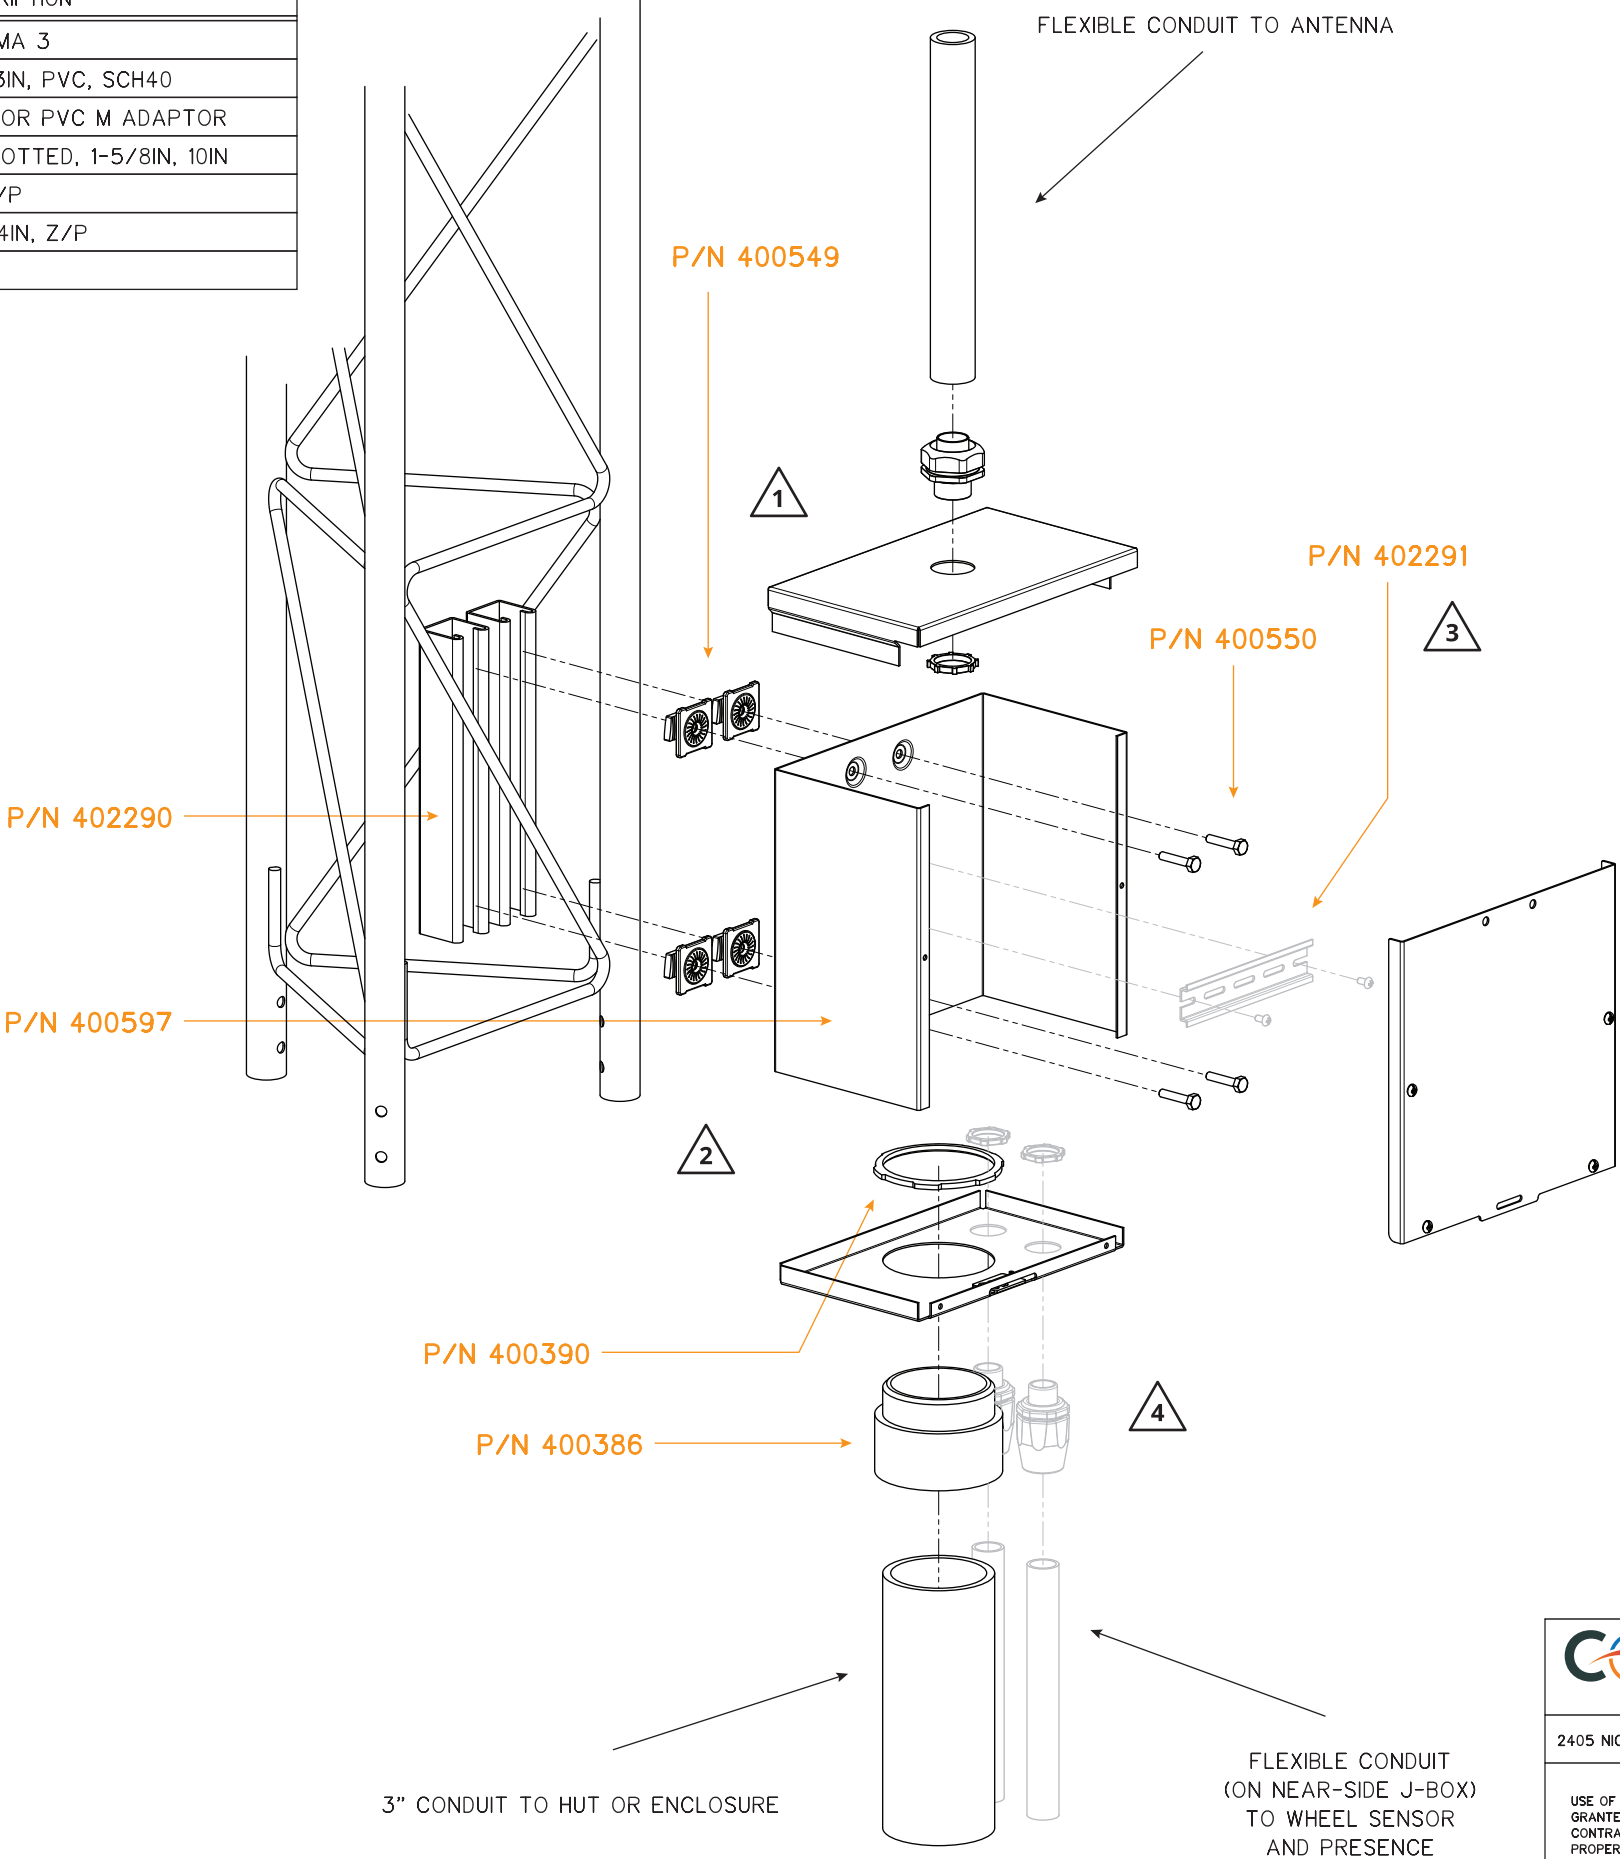

- NOTES :
- J-BOX UNISTRUT MOUNTING PROCEDURE
 - SLIDE SPRING NUTS INTO THE UNISTRUT CHANNELS
 - POSITION THE UNISTRUTS INSIDE THE ROHN TOWER WITH THE CHANNELS FACING OUTWARD AGAINST THE TOWER SUPPORTS
 - INSERT THE FOUR J-BOX MOUNTING BOLTS THROUGH THE BACK OF THE J-BOX AND INTO THE SPRING NUTS
 - TIGHTEN ALL MOUNTING BOLTS SECURELY
 - POSITION THE J-BOX SO THE BOTTOM IS APPROXIMATELY LEVEL WITH THE TOP OF RAIL
 - NEAR-SIDE CONFIGURATION REQUIRES INSTALLATION OF DIN RAIL ON THE BACK OF THE J-BOX TO SUPPORT WIRING TERMINALS (MOUNTING SCREWS NOT INCLUDED)
 - FAR-SIDE CONFIGURATION REQUIRES PLUGGING ANY PRE-DRILLED FLEXIBLE CONDUIT HOLES

	DRAWN	NAME	DATE	TITLE	
	JTW	JTW	07.13.26	J-BOX FIELD INSTALLATION	
	APPROVED	-	-	PART NUMBER	
2405 NICHOLSON AVE, KANSAS CITY, MO 64120		DIVISION		DESCRIPTION	
USE OF THIS DOCUMENT AND INFORMATION IS ONLY GRANTED UNDER CONSIDERATION OF OR USE UNDER CONTRACTUAL AGREEMENT. THIS DOCUMENT IS PROPERTY OF COMET INDUSTRIES AND MUST BE RETURNED / DESTROYED ON REQUEST.		ELECTRONICS		J-BOX FIELD	
		SERIES		INSTALLATION NOTES AND MEASUREMENTS	
		PROJECT		DWG NO.	VERSION
		---		481511	-
				SCALE	SHEET
				NTS	1 OF 1